

# Standard Specification for U-Bend Seamless Copper and Copper Alloy Heat Exchanger and Condenser Tubes<sup>1</sup>

This standard is issued under the fixed designation B395/B395M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the U.S. Department of Defense.*

## 1. Scope\*

1.1 This specification<sup>2</sup> establishes the requirements for condenser, evaporator, and heat exchanger U-bend tubes that are manufactured from seamless copper and copper alloy tube.

1.2 *Units*—The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.3 This specification is applicable to product 2 in. [50 mm] or less, inclusive, in diameter.

1.4 The product shall be produced from one of the following coppers or copper alloys, as specified in the ordering information:

| Copper or<br>Copper Alloy<br>UNS No. | Previously Used<br>Designation | Type of Metal                           |
|--------------------------------------|--------------------------------|---|
| C10200                               | OF <sup>A</sup>                | oxygen-free without residual deoxidants |
| C10300                               | ...                            | oxygen-free, extra low phosphorus       |
| C10800                               | ...                            | oxygen-free, low phosphorus             |
| C12000                               | DLP <sup>A</sup>               | phosphorized, low residual phosphorus   |
| C12200                               | DHP <sup>A</sup>               | phosphorized, high residual phosphorus  |
| C14200                               | DPA <sup>A</sup>               | phosphorized, arsenical                 |
| C19200                               | ...                            | phosphorized, 1 % iron                  |
| C23000                               | ...                            | red brass                               |
| C44300                               | Type B                         | admiralty metal                         |
| C44400                               | Type C                         | admiralty metal                         |
| C44500                               | Type D                         | admiralty metal                         |
| C60800                               | ...                            | aluminum bronze                         |
| C68700                               | Type B                         | aluminum brass                          |
| C70400                               | ...                            | 95-5 copper-nickel                      |
| C70600                               | ...                            | 90-10 copper-nickel                     |

| Copper or<br>Copper Alloy<br>UNS No. | Previously Used<br>Designation | Type of Metal                                  |
|--------------------------------------|--------------------------------|--|
| C70620                               | ...                            | 90-10 copper-nickel-<br>(modified for welding) |
| C71000                               | ...                            | 80-20 copper-nickel                            |
| C71500                               | ...                            | 70-30 copper-nickel                            |
| C71520                               | ...                            | 70-30 copper-nickel-<br>(modified for welding) |
| C72200                               | ...                            | copper-nickel                                  |

<sup>A</sup> Designations listed in Classification B224.

1.5 The following safety hazard caveat pertains only to the test methods described in this specification.

1.5.1 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

2.1 The following documents of the issue in effect on date of material purchase form a part of this specification to the extent referenced herein:

### 2.2 ASTM Standards:<sup>3</sup>

**B153** Test Method for Expansion (Pin Test) of Copper and Copper-Alloy Pipe and Tubing

**B154** Test Method for Mercurous Nitrate Test for Copper Alloys

**B224** Classification of Coppers

**B601** Classification for Temper Designations for Copper and Copper Alloys—Wrought and Cast

**B846** Terminology for Copper and Copper Alloys

**B858** Test Method for Ammonia Vapor Test for Determining Susceptibility to Stress Corrosion Cracking in Copper Alloys

**B900** Practice for Packaging of Copper and Copper Alloy Mill Products for U.S. Government Agencies

\*A Summary of Changes section appears at the end of this standard

B968/B968M Test Method for Flattening of Copper and Copper-Alloy Pipe and Tube

E3 Guide for Preparation of Metallographic Specimens

E8/E8M Test Methods for Tension Testing of Metallic Materials

E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

E53 Test Method for Determination of Copper in Unalloyed Copper by Gravimetry

E62 Test Methods for Chemical Analysis of Copper and Copper Alloys (Photometric Methods) (Withdrawn 2010)<sup>4</sup>

E112 Test Methods for Determining Average Grain Size

E118 Test Methods for Chemical Analysis of Copper-Chromium Alloys (Withdrawn 2010)<sup>4</sup>

E243 Practice for Electromagnetic (Eddy Current) Examination of Copper and Copper-Alloy Tubes

E255 Practice for Sampling Copper and Copper Alloys for the Determination of Chemical Composition

E478 Test Methods for Chemical Analysis of Copper Alloys

E2575 Test Method for Determination of Oxygen in Copper and Copper Alloys

2.3 Other Standards:<sup>5</sup>

ASME Boiler and Pressure Vessel Code

### 3. Terminology

3.1 For definitions of terms related to copper and copper alloys, refer to Terminology B846.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *dual-gage tube, n*—a tube which has more than one wall-gage thickness contained within the length of the tube.

3.2.2 *squareness of cut, n*—the maximum deviation of one side of a cross section of tube from the opposite side, when measured against the projected perpendicularity of the plane of the projected center of the tube at the ends.

3.2.3 *u-bend tube, n*—a tube bent 180° in a single plane into a U-shape.

### 4. Ordering Information

4.1 Include the following specified choices when placing orders for product under this specification, as applicable:

4.1.1 ASTM designation and year of issue,

4.1.2 Copper or copper alloy UNS No. designation (Section 6),

4.1.3 Temper (Section 7),

4.1.4 *Dimensions*—X—diameter and wall thickness of the tube (see 12.1 and 12.2),

4.1.5 Schedule of bending radii (must include the number of pieces of each radii) (see 12.2.5),

4.1.6 Length of U-bend tube legs (see 12.2.8),

4.1.7 If the product is to be subsequently welded (see Table 1), and

4.1.8 Intended application, and

4.1.9 If the product is to be for U.S. Government.

4.2 The following options are available but may not be included unless specified at the time of placing of the order when required:

4.2.1 Heat identification or traceability details (see 5.1.2).

4.2.2 Tension test (see 9.1),

4.2.3 Relief anneal of U-bent portion of copper-nickel U-bend tubes (see 7.6),

4.2.4 Dual-gage, a schedule of tubes required in dual-gage and length of heavy gage section must be furnished with this option (see 5.2.2 and 12.2.3),

4.2.5 Flattening Test (Section 10.2).

4.2.6 Expansion Test (Section 10.1).

4.2.7 Certification, if required (see Section 21), and

4.2.8 Mill Test Report, if required (see Section 22).

4.3 If product is purchased for agencies of the U.S. Government, it shall be in accordance with the requirements specified in the Supplementary Requirements section, when specified in the contract or purchase order.

4.4 If product is ordered for ASME Boiler and Pressure Vessel Code Application (See Certification Section 21).

### 5. Materials and Manufacture

5.1 *Materials:*

5.1.1 The material of manufacture shall be of the copper alloys defined in 1.4 and of such quality and purity that the finished product shall have the properties and characteristics prescribed in this specification for the applicable alloy and temper.

5.1.2 When specified in the contract or purchase order that heat identification or traceability is required, the purchaser shall specify the details desired.

NOTE 1—Due to the discontinuous nature of the processing of casting into wrought products, it is not always practical to identify a specific casting analysis with a specific quantity of material.

5.2 *Manufacture:*

5.2.1 The product shall be manufactured by such hot working, cold working and annealing processes as to produce a uniform wrought structure in the finished product.

5.2.2 Tubes required to be U-bent to a small radius shall, if specified, be furnished as dual-gage tubes.

5.2.2.1 These tubes shall be made prior to U-bending with the wall thickness of the central section of the tube length, increased the equivalent of one Stubs' or Birmingham Wire Gage (BWG) thicker than the wall thickness specified for the straight leg portion of the U-bend tube.

5.2.2.2 Unless otherwise specified, dual-gage tubes shall be made to constant inside diameter; that is, the increased wall thickness shall be obtained by increasing the outside diameter of the finished tube in the central heavy gage section.

5.2.3 The bent portion of the U-bend tube shall be substantially uniform in curvature.

### 6. Chemical Composition

6.1 The material shall conform to the chemical composition requirements specified in Table 1 for the copper or copper alloy UNS No. designation specified in the ordering information.

TABLE 1 Chemical Requirements

| Copper or<br>Copper<br>Alloy<br>UNS No. | Composition, %            |         |          |                           |                   |             |                         |                         |           |           |                  |           |                                       |
|---|---------------------------|---------|----------|---------------------------|-------------------|-------------|-------------------------|-------------------------|-----------|-----------|------------------|-----------|---------------------------------------|
|   | Copper                    | Tin     | Aluminum | Nickel,<br>incl<br>Cobalt | Lead,<br>max      | Iron        | Zinc                    | Manganese               | Arsenic   | Antimony  | Phosphorus       | Chromium  | Other<br>Named<br>Elements            |
| C10200 <sup>A,B</sup>                   | 99.95<br>min              | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | ...       | ...       | ...              | ...       | 10 ppm<br>max O                       |
| C10300 <sup>A</sup>                     | 99.95 <sup>C</sup><br>min | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | ...       | ...       | 0.001–0.005      | ...       | ...                                   |
| C10800 <sup>A</sup>                     | 99.95 <sup>C</sup><br>min | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | ...       | ...       | 0.005–0.012      | ...       | ...                                   |
| C12000 <sup>A</sup>                     | 99.90<br>min              | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | ...       | ...       | 0.004–0.012      | ...       | ...                                   |
| C12200 <sup>A</sup>                     | 99.9 min                  | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | ...       | ...       | 0.015–0.040      | ...       | ...                                   |
| C14200 <sup>A</sup>                     | 99.4 min                  | ...     | ...      | ...                       | ...               | ...         | ...                     | ...                     | 0.15–0.50 | ...       | 0.015–0.040      | ...       | ...                                   |
| C19200 <sup>D</sup>                     | 98.5 min                  | ...     | ...      | ...                       | ...               | 0.8–1.2     | 0.20<br>max             | ...                     | ...       | ...       | 0.01–0.04        | ...       | ...                                   |
| C23000 <sup>D</sup>                     | 84.0–86.0                 | ...     | ...      | ...                       | 0.05              | 0.05<br>max | remainder               | ...                     | ...       | ...       | ...              | ...       | ...                                   |
| C44300 <sup>E</sup>                     | 70.0–73.0                 | 0.9–1.2 | ...      | ...                       | 0.07              | 0.06<br>max | remainder               | ...                     | 0.02–0.06 | ...       | ...              | ...       | ...                                   |
| C44400 <sup>E</sup>                     | 70.0–73.0                 | 0.9–1.2 | ...      | ...                       | 0.07              | 0.06<br>max | remainder               | ...                     | ...       | 0.02–0.10 | ...              | ...       | ...                                   |
| C44500 <sup>E</sup>                     | 70.0–73.0                 | 0.9–1.2 | ...      | ...                       | 0.07              | 0.06<br>max | remainder               | ...                     | ...       | ...       | 0.02–0.10        | ...       | ...                                   |
| C60800 <sup>A,F</sup>                   | remainder                 | ...     | 5.0–6.5  | ...                       | 0.10              | 0.10<br>max | ...                     | ...                     | 0.02–0.35 | ...       | ...              | ...       | ...                                   |
| C68700 <sup>A,F</sup>                   | 76.0–79.0                 | ...     | 1.8–2.5  | ...                       | 0.07              | 0.06<br>max | remainder               | ...                     | 0.02–0.06 | ...       | ...              | ...       | ...                                   |
| C70400 <sup>A,F</sup>                   | remainder                 | ...     | ...      | 4.8–6.2                   | 0.05              | 1.3–1.7     | 1.0<br>max              | 0.30 to<br>0.8          | ...       | ...       | ...              | ...       | ...                                   |
| C70600 <sup>A,F</sup>                   | remainder                 | ...     | ...      | 9.0–11.0                  | 0.05              | 1.0–1.8     | 1.0<br>max              | 1.0 max <sup>G</sup>    | ...       | ...       | ...              | ...       | ...                                   |
| C70620 <sup>A,F</sup>                   | 86.5 min                  | ...     | ...      | 9.0–11.0                  | 0.02              | 1.0–1.8     | 0.50<br>max             | 1.0 max                 | ...       | ...       | 0.02 max         | ...       | 0.05C max<br>0.02S max <sup>G</sup>   |
| C71000 <sup>A,F,G</sup>                 | remainder                 | ...     | ...      | 19.0–23.0                 | 0.05 <sup>G</sup> | 1.0<br>max  | 1.0<br>max <sup>G</sup> | 1.0<br>max <sup>G</sup> | ...       | ...       | <sup>G</sup>     | ...       | ...                                   |
| C71500 <sup>A,F</sup>                   | remainder                 | ...     | ...      | 29.0–33.0                 | 0.05              | 0.40–1.0    | 1.0<br>max              | 1.0 max                 | ...       | ...       | ...              | ...       | ...                                   |
| C71520 <sup>A,F</sup>                   | 65.0 min                  | ...     | ...      | 29.0–33.0                 | 0.02              | 0.40–1.0    | 0.50<br>max             | 1.0 max                 | ...       | ...       | 0.02 max         | ...       | 0.05C max<br>0.02S max <sup>G,H</sup> |
| C72200 <sup>A,D,G</sup>                 | remainder                 | ...     | ...      | 15.0–18.0                 | 0.05 <sup>G</sup> | 0.50–1.0    | 1.0<br>max <sup>G</sup> | 1.0 max                 | ...       | ...       | ... <sup>G</sup> | 0.30–0.70 | ...                                   |

<sup>A</sup> Silver counting as copper.

<sup>B</sup> This is a high conductivity copper which has, in the annealed condition, a minimum conductivity of 101 % IACS.

<sup>C</sup> Includes P.

<sup>D</sup> Cu + sum of named elements, 99.8 % min.

<sup>E</sup> Cu + sum of named elements, 99.6 % min.

<sup>F</sup> Cu + sum of named elements, 99.5 % min.

<sup>G</sup> When the product is for subsequent welding applications, and so specified by the purchaser, zinc shall be 0.50 %, max, lead 0.02 %, max, phosphorus 0.02 %, max, sulfur 0.02 %, max, and carbon 0.05 %, max.

<sup>H</sup> Silicon shall be 0.03 % max, titanium shall be 0.03 % max.

6.1.1 Results of analysis on a product (check) sample shall conform to the composition requirements within the permitted analytical variance specified in **Table 1**.

6.2 These composition limits do not preclude the presence of unnamed elements. By agreement between the manufacturer and purchaser, limits may be established and analysis required for unnamed elements.

6.3 *Copper Alloy UNS No. C19200*—Copper may be taken as the difference between the sum of all the elements analyzed and 100 %.

6.4 For copper alloys in which copper is specified as the remainder, copper may be taken as the difference between the sum of all the elements analyzed and 100 %.

6.5 For copper alloys in which zinc is specified as the remainder, either copper or zinc may be taken as the difference between the sum of all the elements analyzed and 100 %.

## 7. Temper

7.1 Tempers, as defined in Practice **B601**, are as follows:

7.2 Prior to U-bending, tubes of Copper Alloy UNS Nos. C23000, C44300, C44400, C44500, C60800, C68700, C70400, C70600, C70620, C71000, C71500, C71520, and C72200 shall be in the annealed temper (O61), unless otherwise specified in the purchase order.

7.3 Prior to bending, U-bend tubes of Copper Alloy UNS Nos. C10200, C10300, C10800, C12000, C12200, and C14200 shall be in light drawn temper (H55). Tubes of Copper Alloy UNS Nos. C70400, C70600, C70620, and C72200 shall, if specified, be made in the light-drawn temper (H55).

7.4 Prior to bending, U-bend tubes of Copper Alloy UNS No. C19200 shall be in the annealed (O61) or light drawn temper (H55) as specified.

7.5 Prior to bending, U-bend tubes of Copper Alloy UNS No. C71500 or C71520 shall be made in the drawn, stress-relieved temper (HR50), when specified.

7.6 The U-bend portion of tubes furnished in Copper Alloy UNS Nos. C23000, C44300, C44400, C44500, C60800, and C68700 shall be relief annealed (HR) after bending. If specified, the U-bend portion of tubes furnished in Copper Alloy UNS Nos. C70400, C70600, C70620, C71000, C71500, C71520, and C72200 shall be relief annealed (HR) after bending.

NOTE 2—Some tubes, when subjected to aggressive environments, may be subject to stress-corrosion cracking failure because of the residual tensile stresses developed in straightening. For such applications, it is suggested that tubes of Copper Alloy UNS Nos. C23000, C44300, C44400, C44500, C60800, and C68700 be subjected to a stress relieving (HR) thermal treatment subsequent to straightening. If required, this must be specified on the purchase order or contract. Tolerances for roundness and length, and the condition of straightness, for tube so ordered, shall be to the requirements agreed upon by the manufacturer and purchaser.

## 8. Grain Size for Annealed Tempers

8.1 Grain size shall be the standard requirement for all product in annealed tempers.

8.2 Acceptance or rejection based upon grain size shall depend only on the average grain size of a test specimen taken from each of two sample portions and each specimen shall be within the limits of 0.010 to 0.045 mm when determined in accordance with Test Method **E112**.

8.3 The requirements of this section do not apply to product of the light-drawn temper (H55) drawn, stress-relieved temper (HR50), or to the U-bent portion of the product.

## 9. Mechanical Property Requirements

### 9.1 Tensile Strength Requirements:

9.1.1 Product specified to meet the requirements of *ASME Boiler and Pressure Vessel Code* shall have tensile properties as prescribed in **Table 2** for product specified in inch-pound units or **Table 3** for product specified in SI units. When tested in accordance with Test Methods **E8/E8M**.

## 10. Performance Requirements

### 10.1 Expansion Test:

**TABLE 2 Tensile Requirements (Inch-Pound)**

NOTE 1—For SI values, see **Table 3**.

| Copper or Copper Alloy UNS No.                 | Temper Designation |                        | Tensile Strength, min, ksi <sup>B</sup> | Yield Strength, <sup>A</sup> min, ksi <sup>B</sup> | Elongation in 2 in., min, % |
|--|--------------------|------------------------|---|--|-----------------------------|
|  | Temper Code        | Temper Name            |   |  |                             |
| C10200, C10300, C10800, C12000, C12200, C14200 | H55                | light drawn            | 36                                      | 30   | ...                         |
| C19200   | H55                | light drawn            | 40                                      | 35   | ...                         |
| C19200   | O61                | annealed               | 38                                      | 12   | ...                         |
| C23000   | O61                | annealed               | 40                                      | 12   | ...                         |
| C44300, C44400, C44500                         | O61                | annealed               | 45                                      | 15   | ...                         |
| C60800   | O61                | annealed               | 50                                      | 19   | ...                         |
| C68700   | O61                | annealed               | 50                                      | 18   | ...                         |
| C70400   | O61                | annealed               | 38                                      | 12   | ...                         |
| C70400   | H55                | light drawn            | 40                                      | 30   | ...                         |
| C70600, C70620                                 | O61                | annealed               | 40                                      | 15   | ...                         |
| C70600, C70620                                 | H55                | light drawn            | 45                                      | 35   | ...                         |
| C71000   | O61                | annealed               | 45                                      | 16   | ...                         |
| C71500, C71520                                 | O61                | annealed               | 52                                      | 18   | ...                         |
| For wall thicknesses up to 0.048 in., incl     | HR50               | drawn, stress-relieved | 72                                      | 50   | 12                          |
| For wall thicknesses over 0.048 in.            | HR50               | drawn, stress-relieved | 72                                      | 50   | 15                          |
| C72200   | O61                | annealed               | 45                                      | 16   | ...                         |
| C72200   | H55                | light drawn            | 50                                      | 45   | ...                         |

TABLE 3 Tensile Requirements (SI)

NOTE 1—For Inch-Pound values, see Table 2.

| Copper or Copper Alloy UNS No.                 | Temper Designation |                        | Tensile Strength, min, MPa | Yield Strength, <sup>A</sup> min, MPa | Elongation in 50.8 mm, min, % |
|--|--------------------|------------------------|----------------------------|---------------------------------------|-------------------------------|
|  | Temper Code        | Temper Name            |                            |                                       |                               |
| C10200, C10300, C10800, C12000, C12200, C14200 | H55                | light drawn            | 250                        | 205                                   | ...                           |
| C19200   | H55                | light drawn            | 275                        | 240                                   | ...                           |
| C19200   | O61                | annealed               | 260                        | 85                                    | ...                           |
| C23000   | O61                | annealed               | 275                        | 85                                    | ...                           |
| C44300, C44400, C44500                         | O61                | annealed               | 310                        | 105                                   | ...                           |
| C60800   | O61                | annealed               | 345                        | 130                                   | ...                           |
| C68700   | O61                | annealed               | 345                        | 125                                   | ...                           |
| C70400   | O61                | annealed               | 260                        | 85                                    | ...                           |
| C70400   | H55                | light drawn            | 275                        | 205                                   | ...                           |
| C70600, C70620                                 | O61                | annealed               | 275                        | 105                                   | ...                           |
| C70600, C70620                                 | H55                | light drawn            | 310                        | 240                                   | ...                           |
| C71000   | O61                | annealed               | 310                        | 110                                   | ...                           |
| C71500, C71520:                                | O61                | annealed               | 360                        | 125                                   | ...                           |
| For wall thicknesses up to 1.2 mm, incl        | HR50               | drawn, stress-relieved | 495                        | 345                                   | 12                            |
| For wall thicknesses over 1.2 mm               | HR50               | drawn, stress-relieved | 495                        | 345                                   | 15                            |
| C72200   | O61                | annealed               | 310                        | 110                                   | ...                           |
| C72200   | H55                | light drawn            | 345                        | 310                                   | ...                           |

10.1.1 When specified in the contract or purchaser order, tube specimens selected for test shall withstand the expansion shown in Table 4 when expanded in accordance with Test Method B153.

10.1.2 The expanded tube shall show no cracking or other defects visible to the unaided eye.

#### 10.2 Flattening Test:

10.2.1 When specified in the contract or purchase order, the flattening test in accordance with Test Method B968/B968M shall be performed.

10.2.2 During inspection, the flattened areas of the test specimen shall be free of defects, but blemishes of a nature that do not interfere with the intended application are acceptable.

#### 10.3 Residual Stress Test:

10.3.1 Product manufactured from Copper Alloy UNS Nos. C23000, C44300, C44400, C44500, C60800 and C68700 shall be tested for residual stress according to the requirements of Test Method B154 or Test Method B858 and show no signs of cracking.

**Warning**—Mercury is a definite health hazard. With the Mercurous Nitrate Test, equipment for the detection and removal of mercury vapor produced in volatilization, and the use of protective gloves is recommended.

10.3.2 When the Ammonia Vapor Test is used, the test pH value appropriate for the intended application shall be 10 unless otherwise specified by the purchaser.

10.3.3 Residual stress test specimens shall be from both the U-bend and straight leg length and tested without bending, springing, polishing, or any other preparation, except as allowed by the test method.

NOTE 3—A residual stress test provides information about the adequacy of the stress relief of the material. Stress relief annealing is a method of thermal stress relief. There is no standard test method to evaluate the effectiveness of a relief-anneal (HR) of the U-bend section of copper-nickel or copper-nickel-iron tubes with respect to stress-corrosion cracking susceptibility.

TABLE 4 Expansion Requirements

| Temper Designation |                        | Copper or Copper Alloy UNS No.         | Expansion of Tube Outside Diameter in Percent Of Original Outside Diameter |
|--------------------|------------------------|--|--|
| Code               | Name                   |  |  |
| O61                | annealed               | C19200                                 | 30   |
|                    |                        | C23000                                 | 20   |
|                    |                        | C44300, C44400, C44500                 | 20   |
|                    |                        | C60800                                 | 20   |
|                    |                        | C68700                                 | 20   |
|                    |                        | C70400                                 | 30   |
|                    |                        | C70600, C70620                         | 30   |
|                    |                        | C71000                                 | 30   |
|                    |                        | C71500, C71520                         | 30   |
|                    |                        | C72200                                 | 30   |
| H55                | light-drawn            | C10200, C10300, C10800, C12000, C12200 | 20   |
|                    |                        | C14200                                 | 20   |
|                    |                        | C19200                                 | 20   |
|                    |                        | C70400                                 | 20   |
|                    |                        | C70600, C70620                         | 20   |
|                    |                        | C72200                                 | 20   |
|                    |                        | C71500, C71520                         | 20   |
|                    |                        |  |  |
|                    |                        |  |  |
|                    |                        |  |  |
| HR58               | drawn, stress relieved | C71500, C71520                         | 20   |
|                    |                        |  |  |

## 11. Other Requirements

### 11.1 Nondestructive Examination for Defects:

11.1.1 Each tube, prior to bending, shall be subjected to the eddy-current test.

11.1.2 Tubes may be tested in the final drawn, annealed, or heat-treated temper or in the drawn temper prior to the final anneal or heat treatment at the option of the manufacturer.

11.1.3 Testing shall follow the procedures of Practice E243.

11.1.4 Unless otherwise agreed upon between the manufacturer, or supplier, and the purchaser, the manufacturer shall have the option of calibrating the test equipment using either notch-depth or drilled-hole standards. If agreement cannot be reached, notch-depth standard shall be utilized.

11.1.5 The depth of the round-bottom transverse notches and the diameters of the drilled holes in the calibrating tube



used to adjust the sensitivity of the test unit are shown in [Table 5](#) and [Table 7](#) for the material specified in the inch-pound system and [Table 6](#) and [Table 8](#) for material specified in the SI system.

11.1.6 Tubes that do not actuate the signaling device of the eddy-current tester shall be considered as conforming to the requirements of this test.

11.1.7 Tubes causing irrelevant signals because of moisture, soil, and minor mechanical damage may be reconditioned and retested.

11.1.8 Such tubes, when retested to the original test parameters, shall be considered to conform if they do not cause output signals beyond the acceptable limits.

11.1.9 Tubes causing irrelevant signals because of visible and identifiable handling marks shall be considered in conformance if the tube dimensions are within the prescribed limits and if the tubes conform to the leak test requirements of [11.2.2](#) or [11.2.3](#), unless otherwise agreed to by the manufacturer and purchaser.

11.2 Each U-bend tube shall be tested to the requirements of either [11.2.2](#) or [11.2.3](#).

11.2.1 Unless otherwise specified, the manufacturer shall have the option of the leak test to be used.

11.2.2 *Hydrostatic Test*—Each tube shall withstand an internal hydrostatic-pressure sufficient to subject the material to a fiber stress of 7000 psi [48 MPa] without evidence of leakage. The tube need not be tested at a hydrostatic pressure of over a gage pressure of 1000 psi [6.9 MPa], unless so specified. The stress shall be determined by the following equation for thin hollow cylinders under tension:

$$P = 2St/(D - 0.8t) \quad (1)$$

where:

- $P$  = hydrostatic pressure, psi [MPa],
- $t$  = thickness of tube wall, in. [mm],
- $D$  = outside diameter of the tube, in. [mm], and
- $S$  = allowable stress of the material, psi [MPa].

11.2.3 *Pneumatic Test*—Each tube shall be subjected to an internal air gage pressure of 60 psi [400 kPa], minimum. The product shall maintain pressure and show no evidence of leakage for 5 s. The test method used shall permit visual detection of any leakage, such as by having the tube under water or by the pressure differential method. Any evidence of leakage shall be cause for rejection.

## 12. Dimensions, Mass, and Permissible Variations

12.1 *Tube Diameter*—The outside diameter of the straight leg portion of the tube, exclusive of the central heavy gage portion, shall not vary from that specified by more than the

**TABLE 5 Notch Depth**

| Tube Wall Thickness, in. | Tube Outside Diameter, in. |                    |                    |
|--------------------------|----------------------------|--------------------|--------------------|
|                          | Over ¼ to ¾, incl          | Over ¾ to 1¼, incl | Over 1¼ to 2, incl |
| Over 0.017–0.032         | 0.005                      | 0.006              | 0.007              |
| Incl, 0.032–0.049        | 0.006                      | 0.006              | 0.0075             |
| Incl, 0.049–0.083        | 0.007                      | 0.0075             | 0.008              |
| Incl, 0.083–0.109        | 0.0075                     | 0.0085             | 0.0095             |
| Incl, 0.109–0.120        | 0.009                      | 0.009              | 0.011              |

**TABLE 6 Notch Depth (SI)**

| Tube Wall Thickness, mm | Tube Outside Diameter, mm |                     |                     |
|-------------------------|---------------------------|---------------------|---------------------|
|                         | Over 6 to 19, incl        | Over 19 to 32, incl | Over 32 to 50, incl |
| Over 0.43–0.81          | 0.13                      | 0.15                | 0.18                |
| Incl, 0.81 to 1.3       | 0.15                      | 0.15                | 0.19                |
| Incl, 1.3 to 2.1        | 0.18                      | 0.19                | 0.20                |
| Incl, 2.1 to 2.8        | 0.19                      | 0.22                | 0.24                |
| Incl, 2.8 to 3.0        | 0.23                      | 0.23                | 0.28                |

**TABLE 7 Diameter of Drilled Holes**

| Tube Outside Diameter, in. | Diameter of Drilled Holes, in. | Drill No. |
|----------------------------|--------------------------------|-----------|
| 1/4 to 3/4, incl           | 0.025                          | 72        |
| Over 3/4, incl             | 0.031                          | 68        |
| Over 1–1¼, incl            | 0.036                          | 64        |
| Over 1¼–1½, incl           | 0.042                          | 58        |
| Over ½–¾, incl             | 0.046                          | 56        |
| Over ¾, incl               | 0.052                          | 55        |

**TABLE 8 Diameter of Drilled Holes (SI)**

| Tube Outside Diameter, mm | Diameter of Drilled Holes, mm | Drill No. |
|---------------------------|-------------------------------|-----------|
| 6.0–19.0, incl            | 0.635                         | 72        |
| Over 19.0–25.0, incl      | 0.785                         | 68        |
| Over 25.0–32.0, incl      | 0.915                         | 64        |
| Over 32.0–38.0, incl      | 1.07                          | 58        |
| Over 38.0–45.0, incl      | 1.17                          | 56        |
| Over 45.0–50.0, incl      | 1.32                          | 55        |

amounts shown in [Table 9](#) for product specified in the inch-pound system or [Table 10](#) for product specified in the SI system as measured by “go” and “no-go” ring gages.

### 12.2 Thickness:

12.2.1 *Tubes Ordered to Minimum Wall*—Prior to bending, the wall thickness of the single-gage tubes at the thinnest point shall not be less than the thickness specified. The maximum plus deviation from the specified wall at any point shall not exceed twice the value shown in [Table 11](#) for product specified in the inch-pound system or [Table 12](#) for product specified in the SI system.

### 12.2.2 Tubes Ordered to Nominal Wall:

12.2.2.1 Prior to bending the maximum plus and minus deviation from the nominal wall at any point shall not exceed the values shown in [Table 11](#) for product specified in the inch-pound system or [Table 12](#) for product specified in the SI system.

12.2.2.2 When tubes are required in dual-gage, the wall thickness of the heavy gage portion, prior to bending, shall conform to the applicable tolerances in [Table 11](#) or [Table 12](#) for the specified heavier gage ([Note 4](#)).

**NOTE 4**—The wall thickness of the heavy-gage section of the dual-gage tube shall be determined by adding one half the difference between the outside diameter at the heavy gage and the outside diameter of the standard gage to the minimum measured wall thickness determined at either end of the tube.

12.2.3 *Wall Thickness of Tube in U-Bend Section*—The wall thickness of the tube at the apex of the U-bent section shall be not less than the value determined by the following equation:

TABLE 9 Diameter Tolerances

| Outside Diameter, in.                   | Wall Thickness, in. |        |        |                |
|---|---------------------|--------|--------|----------------|
|   | 0.032               | 0.035  | 0.042  | 0.049 and Over |
| Diameter Tolerance, Plus and Minus, in. |                     |        |        |                |
| Up to 0.500 incl                        | 0.0025              | 0.0025 | 0.0025 | 0.0025         |
| Over 0.500–0.740, incl                  | 0.004               | 0.004  | 0.0035 | 0.003          |
| Over 0.740–1.000, incl                  | 0.006               | 0.005  | 0.0045 | 0.004          |
| Over 1.000–1.250, incl                  | 0.009               | 0.008  | 0.006  | 0.0045         |
| Over 1.250–1.375, incl                  | ...                 | ...    | 0.008  | 0.005          |
| Over 1.375–2.000, incl                  | ...                 | ...    | ...    | 0.006          |

TABLE 10 Diameter Tolerances (SI)

| Outside Diameter, mm                   | Wall Thickness, mm |       |       |               |
|--|--------------------|-------|-------|---------------|
|  | 0.813              | 0.889 | 1.07  | 1.24 and Over |
| Diameter Tolerance, Plus and Minus, mm |                    |       |       |               |
| Up to 12.0, incl                       | 0.064              | 0.064 | 0.064 | 0.064         |
| Over 12.0–18.0, incl                   | 0.010              | 0.10  | 0.089 | 0.076         |
| Over 18.0–25.0, incl                   | 0.15               | 0.13  | 0.11  | 0.10          |
| Over 25.0–35.0, incl                   | ...                | ...   | 0.20  | 0.13          |
| Over 35.0–50.0, incl                   | ...                | ...   | ...   | 0.15          |

TABLE 11 Wall Thickness Tolerances

| Wall Thickness, in.                           | Outside Diameter, in. |                     |                   |
|---|-----------------------|---------------------|-------------------|
|   | Over 1/8 to 5/8, incl | Over 5/8 to 1, incl | Over 1 to 2, incl |
| Wall Thickness Tolerances, Plus and Minus in. |                       |                     |                   |
| 0.032, incl to 0.035                          | 0.003                 | 0.003               | 0.004             |
| 0.035, incl to 0.058                          | 0.004                 | 0.0045              | 0.0045            |
| 0.058, incl to 0.083                          | 0.0045                | 0.005               | 0.005             |
| 0.083, incl to 0.120                          | 0.005                 | 0.0065              | 0.0065            |
| 0.120, incl to 0.134                          | 0.007                 | 0.007               | 0.0075            |

TABLE 12 Wall Thickness Tolerances (SI)

| Wall Thickness, mm                           | Outside Diameter, mm   |                         |                         |
|--|------------------------|-------------------------|-------------------------|
|  | Over 3.0 to 16.0, incl | Over 16.0 to 25.0, incl | Over 25.0 to 50.0, incl |
| Wall Thickness Tolerances, Plus and Minus mm |                        |                         |                         |
| 0.813, incl to 0.889                         | 0.076                  | 0.076                   | 0.10                    |
| 0.889, incl to 1.47                          | 0.10                   | 0.11                    | 0.11                    |
| 1.47, incl to 2.11                           | 0.11                   | 0.13                    | 0.13                    |
| 2.11, incl to 3.05                           | 0.13                   | 0.17                    | 0.17                    |
| 3.05, incl to 3.40                           | 0.18                   | 0.18                    | 0.19                    |

$$t_f = t(2R)/(2R + D) \quad (2)$$

where:

- $t_f$  = thickness after bending, in. [mm],  
 $t$  = specified thickness of minimum wall or specified nominal wall minus the permissible wall thickness tolerance, in. [mm],  
 $R$  = centerline bend radius, in. [mm], and  
 $D$  = nominal outside diameter of the tube, in. [mm]

Proof of conformance to this requirement shall be obtained by bending a tube specimen representative of the material offered to the scheduled radius of bend cutting the tube at the apex of the bend, measuring the tube wall at the cross section

of this apex section, and comparing the measured value with the calculated value of  $t_f$ .

**12.2.4 Length of Central Heavy-Gage Section of Tube**—The nominal length of the heavy-gage section of the dual-gage tube prior to bending shall be as specified but in no case shall the length of the heavy-gage section be specified less than 4 in. [100 mm] nor less than the length of the bend measured along the centerline bend radius between the points of tangency. The tolerance on the length of the heavy gage section shall be plus 3 in. [76 mm], minus 0 in. [0 mm]. The transition from the larger tube diameter of the heavy-gage section to the diameter of the tube in the standard-gage section shall be gradual and take place in a distance of not less than 1/8 in. [3.2 mm] nor more than 1 in. [25 mm] measured parallel to the tube axis.

**12.2.5 Centering of U-Bend in Heavy-Gage Section of Tube**—U-bends in the dual-gage tube shall be centered substantially within the heavy-gage section of the tube. The heavy-gage section of the tube shall extend to or beyond the point of tangency, that is, the dimension  $a$  in Fig. 1 may be equal to or greater than 0 in. [0 mm]. The difference  $(b - a)$  between the lengths of the heavy-gage section which extend beyond the point of tangency into the U-bend tube legs shall not exceed 1 in. [25 mm].

**12.2.6 Bending Radius**—The leg spacing, measured between the points of tangency of the bend to the legs shall not vary from the value  $(2R - \text{specified tube outside diameter})$  by more than 1/16 in. [1.6 mm] where  $R$  is the specified centerline bend radius (Note 5).

NOTE 5—The higher tensile properties recognized by the ASME Code for Copper Alloy UNS No. C71500 or C71520 in the drawn, stress-relieved temper (HR50) and Copper UNS Nos. C10200, C10300, C10800, C12000, C12200, C14200, and Copper Alloy No. C70400 in the light-drawn temper (H55) are obtained with some sacrifice of ductility. Similarly, though the ASME Code does not recognize Copper Alloy UNS No. C70600 or C70620 in the light-drawn temper (H55), tubes in this temper are frequently required.

NOTE 6—The radius of the bend of tubes of C71500 or C71520, in the

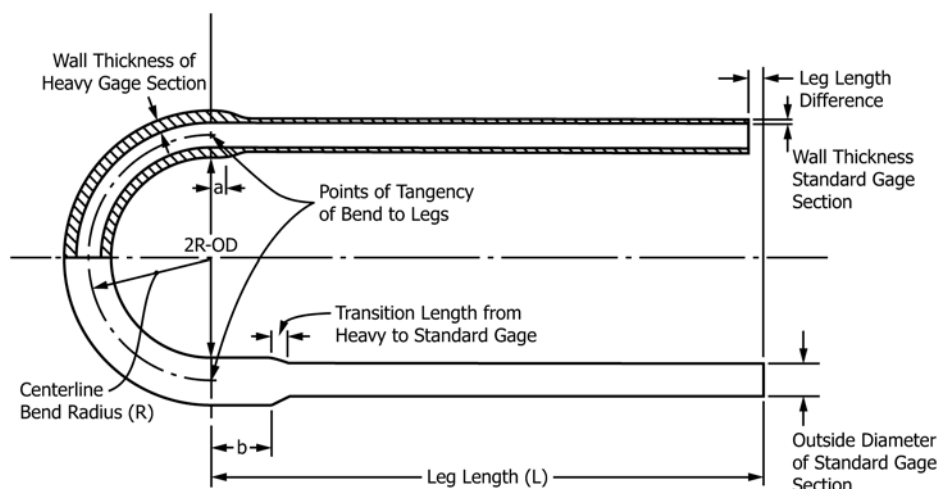


FIG. 1 Centering of U-Bend in Heavy Gage Section of Tube

drawn stress-relieved temper (HR50), shall not be less than 2.2 times the tube outside diameter for tubes with 0.049-in. [1.24 mm] wall, and not less than two times the tube outside diameter for tubes with 0.058 in. [1.47 mm] wall.

**12.2.7 Diameter of Tube in U-Bent Section**—Neither the major, nor the minor outside diameter of the tube at any one cross section included within the points of tangency of the bend shall deviate from the nominal diameter prior to bending by more than 10 %.

**12.2.8 Length of U-Bend Tube Legs**—The length  $L$  in Fig. 1 of the tube legs as measured from the point of tangency of the bend and the tube leg to the end of the tube leg shall not be less than that specified when measured at a temperature of 68°F [20°C], but may exceed the specified values by the amounts shown in Table 13 for product specified in the inch-pound system or Table 14 for product specified in the SI system.

**12.2.8.1** The difference in length of the tube legs shall not be greater than 1/8 in. [3.2 mm], unless otherwise specified.

**12.2.9 Squareness of Cut**—The departure from squareness of the end of any tube shall not exceed the values given in Table 15 for product specified in the inch-pound system or Table 16 for product specified in the SI system. See Fig. 2.

### 13. Workmanship, Finish, and Appearance

**13.1** The product shall be free of defects, but blemishes of a nature that do not interfere with the intended application are acceptable.

**13.2** Annealed-temper (O61) tubes shall be clean and smooth, but may have a superficial, dull iridescent film on both the inside and outside surface. Drawn-temper tubes shall be clean and smooth, but may have a superficial film of drawing lubricant on the surfaces. A light oxide scale on the outside and

TABLE 14 Tube Leg Tolerances (SI)

| Specified Length, (L) mm | Tolerance all Plus, mm |
|--------------------------|------------------------|
| Up to 6000, incl         | 3.2                    |
| Over 6000–9000, incl     | 4.0                    |
| Over 9000–18 000, incl   | 6.4                    |
| Over 18 000              | 9.5                    |

TABLE 15 Squareness Tolerances

| Specified Outside Diameter, in. | Tolerance     |
|---------------------------------|---------------|
| Up to 5/8, incl                 | 0.010 in.     |
| Over 5/8                        | 0.016 in./in. |

TABLE 16 Squareness Tolerances (SI)

| Specified Outside Diameter, mm | Tolerance   |
|--------------------------------|-------------|
| Up to 16.0, incl               | 0.25 mm     |
| Over 16.0                      | 0.016 mm/mm |

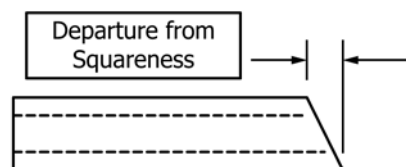


FIG. 2 Squareness of Cut

inside surfaces of U-bend tubes shall be allowed for tubes which have been relief annealed.

### 14. Sampling

**14.1** The lot size, portion size, and selection of pieces shall be as follows:

**14.1.1 Lot Size**—For purposes of testing, a lot shall consist of 600 tubes or fraction thereof, for tubes whose lengths prior to U-bending are up to and including 45 ft [13 800 mm] or 300 tubes or fraction thereof for tubes whose lengths prior to U-bending are over 45 ft [13 800 mm]. As tubes intended for U-bending are of different lengths depending on the bending radius, a lot of tubes for sampling purposes may include tubes

TABLE 13 Tube Leg Tolerances

| Specified Length, (L) ft | Tolerance all Plus, in. |
|--------------------------|-------------------------|
| Up to 20, incl           | 1/8                     |
| Over 20–30, incl         | 5/22                    |
| Over 30–60, incl         | 1/4                     |
| Over 60                  | 3/8                     |



of different lengths. If any order includes tubes whose lengths prior to bending are both under and over 45 ft [13 800 mm], those tubes shall be divided into separate lots as noted above.

14.1.2 *Portion Size*—Pieces from two tubes selected from each lot prior to bending.

#### 14.2 *Chemical Analysis*:

14.2.1 Samples for chemical analysis shall be taken in accordance with Practice E255. Drillings, millings, and so forth, shall be taken in approximately equal weight from each of the sample pieces selected in accordance with 14.1.2 and combined into one composite sample. The minimum weight of the composite sample that is to be divided into three equal parts shall be 0.33 lb [150 g].

14.2.1.1 Instead of sampling in accordance with Practice E255, the manufacturer shall have the option of determining conformance to chemical composition as follows: Conformance shall be determined by the manufacturer by analyzing samples taken at the time the castings are poured or samples taken from the semi-finished product. If the manufacturer determines the chemical composition of the material during the course of manufacture, he shall not be required to sample and analyze the finished product.

14.2.1.2 The number of samples taken for determination of chemical composition shall be as follows:

(a) When samples are taken at the time the castings are poured, at least one sample shall be taken for each group of castings poured simultaneously from the same source of molten metal.

(b) When samples are taken from the semi-finished product, a sample shall be taken to represent each 10 000 lb [4550 kg] or fraction thereof, except that not more than one sample shall be required per piece.

(c) Due to the discontinuous nature of the processing of castings into wrought products, it is not practical to identify specific casting analysis with a specific quantity of finished material.

(d) In the event that heat identification or traceability is required, the purchaser shall specify the details desired.

### 15. Number of Tests and Retests

#### 15.1 *Test*:

15.1.1 *Chemical Analysis*—One composite sample shall be subjected to the test as defined in 14.2.

15.1.2 *Grain Size*—Two tubes shall be selected from each lot prior to bending and each tube shall be tested to verify the requirements in Section 8.

15.1.3 *Tensile Property Requirements*—Two tubes shall be selected from each lot prior to bending and each tube shall be tested to verify the requirements in Section 9.

15.1.4 *Expansion Test*—Two tubes shall be selected from each lot prior to bending and each tube shall be tested to verify the requirements in Section 10.

15.1.5 *Flattening Test*—Two tubes shall be selected from each lot prior to bending and each tube shall be tested to verify the requirement in 10.2.

15.1.6 *Mercurous Nitrate Test or Ammonia Vapor Test*—The two sample lengths selected for test specimens in 14.1 shall be tested to verify the requirements of 10.3.1.

#### 15.2 *Retest*:

15.2.1 When requested by the manufacturer or supplier, a retest shall be permitted when results of tests obtained by the purchaser fail to conform to the requirements of the product specification.

15.2.2 The retest shall be as directed in the product specification for the initial test, except the number of test specimens shall be twice that normally required for the specified test.

15.2.3 All test specimens shall conform to the product specification requirement(s) in retest. Failure to conform shall be cause for rejection.

### 16. Specimen Preparation

#### 16.1 *Chemical Analysis*:

16.1.1 Sample preparation shall be in accordance with Practice E255.

16.1.2 Analytical specimen preparation shall be the responsibility of the reporting laboratory.

16.2 *Grain Size*—The test specimen shall be prepared in accordance with Test Method E3 and shall approximate a longitudinal section of the tube.

#### 16.3 *Tension Test*:

16.3.1 Tension test specimens shall be of the full section of tube and shall conform to the requirements of the Test Specimen section of Test Methods E8/E8M, as applicable unless the limitations of the testing machine precludes the use of such a specimen. Test specimens conforming to Type No. 1 of Fig. 13, Tension Test Specimens for Large-Diameter Tubular Products, of Test Methods E8/E8M shall be used when a full section specimen cannot be tested.

16.3.2 Tension test results on product covered by this specification are not seriously affected by variations in speed of testing. The rate of stressing to the yield strength shall not exceed 100 ksi/min [690 MPa/mm]. Above the yield strength, the movement per minute of the testing machine head under load should not exceed 0.5 in./in. [0.5 mm/mm], as appropriate of gage length (or distance between grips for full section specimens).

16.4 *Expansion Test Specimen*—Test specimens shall conform to the requirements of the Specimen Preparation section of Test Method B153.

#### 16.5 *Mercurous Nitrate Test or Ammonia Vapor Test*:

16.5.1 A sufficient length of tube taken from each of the two sample lengths selected for test specimens (see 14.1) shall be U-bent to the smallest radius in the contract or purchase order and shall be subjected to the same relief-annealed (HR) treatment to be used for this size in producing the order.

16.5.2 The test specimens shall be cut 6 in. [150 mm] in length from both the U-bend and straight-leg length.

16.5.3 The straight-leg specimens shall include the finished-tube ends.

16.6 *Flattening Test*—A test specimen shall conform to the appropriate requirements of the Test Specimen section of Test Method B968/B968M.

### 17. Test Methods

#### 17.1 *Chemical Composition*:

17.1.1 Chemical compositions for all other alloys, in case of disagreement, shall be determined as follows:

| Element             | Range          | Test Method              |
|---------------------|----------------|--------------------------|
| Copper              | 99.75 to 99.99 | E53, Electrolytic        |
| Copper              | 70.0 to 99.75  | E478, Electrolytic       |
| Tin                 | 0.9 to 1.2     | E478, Photometric        |
| Aluminum            | 1.8 to 6.5     | E478                     |
| Nickel, incl Cobalt | 4.8 to 33.0    | E478, Gravimetric        |
| Lead                | 0.05 to 0.10   | E478, Atomic Absorption, |
| Iron                | 0.04 to 1.8    | E478                     |
| Zinc                | 14.0 to 30.0   | E478, Titrimetric        |
| Zinc                | to 1.0         | E478, Atomic Absorption  |
| Manganese           | to 1.0         | E62                      |
| Arsenic             | 0.02 to 0.5    | E62                      |
| Antimony            | 0.02 to 0.1    | E62                      |
| Phosphorus          | 0.001 to 0.04  | E62                      |
| Chromium            | 0.30 to 0.70   | E118                     |
| Oxygen              | +0.0010        | E2575                    |

## 17.2 Other Tests:

17.2.1 The product furnished shall conform to all other requirements when subjected to testing in accordance with the following table:

|                      |            |
|----------------------|------------|
| Ammonia Vapor Test   | B858       |
| Eddy Current         | E243       |
| Expansion (Pin Test) | B153       |
| Grain Size           | E112       |
| Mercurous Nitrate    | B154       |
| Tension              | E8/E8M     |
| Flattening           | B968/B968M |

17.2.1.1 *Grain Size*—In case of dispute, the intercept method of Test Method E112 shall be followed.

17.2.1.2 *Tension Test*—Whenever tension test results are obtained from both full size and from machined test specimens and they differ, the results obtained from full-size specimens shall prevail.

## 18. Significance of Numerical Limits

18.1 For purpose of determining compliance with the specified limits for requirements of the properties listed in the following table, an observed value or a calculated value shall be rounded as indicated in accordance with the rounding method of Practice E29.

| Property             | Rounded Unit for Observed or Calculated Value   |
|----------------------|---|
| Chemical composition | nearest unit in the last right-hand significant digit used in expressing the limiting value |
| Tensile strength     | nearest ksi [nearest 5 MPa]   |
| Elongation           | nearest 1 %   |
| Expansion            | nearest 1 %   |
| Grain size           | nearest multiple of 0.005 mm  |

## 19. Inspection

19.1 The manufacturer, or supplier, shall inspect and make necessary tests to verify that the furnished product conforms to the specification requirements.

19.2 Source inspection of the product by the purchaser may be agreed upon between the manufacturer, or supplier, and the purchaser as part of the purchase order. In such case, the nature of the facilities needed to satisfy the inspector, representing the purchaser, that the product is being furnished in accordance with the specification shall be included in the agreement. All

testing and inspection shall be conducted so as not to interfere unnecessarily with the operation of the works.

19.3 When mutually agreed upon, the manufacturer, or supplier, and the purchaser shall conduct the final inspection simultaneously.

## 20. Rejection and Rehearing

### 20.1 Rejection:

20.1.1 Product that fails to conform to the requirements of this specification when inspected or tested by the purchaser, or purchaser's agent, shall be subject to rejection.

20.1.2 Rejection shall be reported to the manufacturer or supplier promptly. In addition, a written notification of rejection shall follow.

20.1.3 In case of dissatisfaction with results of the test upon which rejection is based, the manufacturer, or supplier, shall have the option to make claim for rehearing.

### 20.2 Rehearing:

20.2.1 As a result of product rejection, the manufacturer, or supplier, shall have the option to make claim for a retest to be conducted by the manufacturer, or supplier, and the purchaser. Samples of the rejected product shall be taken in accordance with the product specification and subjected to test by both parties using the test method(s) specified in the product specification, or alternately, upon agreement of both parties, an independent laboratory may be selected for the test(s) using the test method(s) specified in the product specification.

## 21. Certification

21.1 When specified in the contract or purchase order, the purchaser shall be furnished certification that samples representing each lot have been either tested or inspected as directed in this specification and requirements have been met.

21.2 When specified in the purchase order or contract that product is purchased for ASME Boiler and Pressure Vessel Code applications, certification to the ASME specification is mandatory.

## 22. Mill Test Report

22.1 When specified in the contract or purchase order, a report of test results shall be furnished.

## 23. Packaging and Package Marking

### 23.1 Packaging:

23.1.1 The material shall be separated by size, composition, and temper, and prepared for shipment in such a manner as to ensure acceptance by common carrier for transportation and in such a manner to afford protection from the normal hazards of transportation.

### 23.2 Package Marking:

23.2.1 Each shipping unit shall be legibly marked with the purchase order number, metal or alloy designation, temper, size, shape, total length of piece count, or both, and name of supplier. The specification number shall be shown, when specified.

## 24. Keywords

24.1 condenser tube; copper; copper alloy; dual-gage; evaporator; heat exchanger; U-bend tube; C10200; C10300;

C10800; C12000; C12200; C14200; C19200; C23000; C44300; C44400; C44500; C60800; C68700; C70400; C70600; C70620; C71000; C71500; C71520; C72200

## SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, or order, for agencies of the U. S. Government.

### S1. Referenced Documents

S1.1 The following documents of the issue in effect on date of material purchase form a part of this specification to the extent referenced herein:

S1.1.1 *Federal Standards*:<sup>6</sup>

Fed. Std. No. 102 Preservation, Packaging and Packing Levels

Fed. Std. No. 123 Marking for Shipment (Civil Agencies)

Fed. Std. No. 185 Identification Marking of Copper and Copper-Base Alloy Mill Products

S1.1.2 *Military Standard*:<sup>6</sup>

MIL-STD-129 Marking for Shipment and Storage

S1.1.3 *ASTM Standard*:

**B900** Practice for Packaging of Copper and Copper-Alloy Mill Products for U.S. Government Agencies

### S2. Quality Assurance

S2.1 *Responsibility for Inspection*:

S2.1.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified. Except as otherwise specified in the contract or purchase order, the manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements

unless disapproved of by the purchaser at the time the order is placed. The purchaser shall have the right to perform any of the inspections or tests set forth when such inspections and tests are deemed necessary to assure that the material conforms to prescribed requirements.

### S3. Identification Marking

S3.1 All material shall be properly marked for identification in accordance with Fed. Std. No. 185 except that the ASTM specification number and the alloy number shall be used.

### S4. Preparation for Delivery

S4.1 *Preservation, Packaging, Packing*:

S4.1.1 *Military Agencies*—The material shall be separated by size, composition, grade or class and shall be preserved and packaged, Level A or C, packed, Level A, B, or C as specified in the contract or purchase order, in accordance with the requirements of Practice **B900**.

S4.1.2 *Civil Agencies*—The requirements of Fed. Std. No. 102 shall be referenced for definitions of the various levels of packaging protection.

S4.2 *Marking*:

S4.2.1 *Military Agencies*—In addition to any special marking required by the contract or purchase order, marking for shipment shall be in accordance with MIL-STD-129.

S4.2.2 *Civil Agencies*—In addition to any special marking required by the contract or purchase order, marking for shipment shall be in accordance with Fed. Std. No. 123.

<sup>6</sup> DLA Document Services, Building 4/D, 700 Robbins Avenue, Philadelphia, PA 19111-5094, <http://quicksearch.dla.mil/>

## SUMMARY OF CHANGES

Committee B05 has identified the location of selected changes to this specification since the last issue (B395/B395M – 08) that may impact the use of this standard. (Approved October 1, 2013)

- (1) General rewrite of the specification to comply with the outline of form, including miscellaneous working changes.
- (2) Welding limits were removed for alloys UNS C70600 and C71500 since the welding compositions were already included in alloys C70620 and C71520.

